


## A/V SYSTEM NOTES

- SEE THE A/V CONSULTANT'S DRAWINGS AND SPECIFICATIONS FOR ALL A/V EQUIPMENT, PANEL, AND DEVICE LOCATIONS AND REQUIREMENTS.
- THE A/V CONTRACTOR (DIVISION 11) WILL PROVIDE AND INSTALL ALL A/V EQUIPMENT, RACKS, DEVICES, PANELS AND A/V SYSTEMS WIRING.
- DIVISION 26 SHALL PROVIDE ALL BACKBOXES, CONDUITS AND RACEWAYS REQUIRED FOR THE A/V SYSTEM IN COORDINATION WITH THE A/V DRAWINGS.
- MAINTAIN ALL SEPARATIONS BETWEEN A/V SYSTEM CONDUITS, AND BETWEEN A/V SYSTEM AND POWER CONDUITS AS STIPULATED BY THE "CONDUIT SEPARATION TABLES" IN SPECIFICATION SECTION 26 05 83.
- SEE E-PL SERIES GENERAL NOTES FOR ADDITIONAL REQUIREMENTS.

## GENERAL NOTES

- A. DEDICATED NEUTRALS REQUIRED FOR ALL BRANCH CIRCUITS.
- B. ELECTRICAL DEVICES ON FIRE-RATED WALLS TO BE INSTALLED 24" APART MINIMUM.
- C. PROVIDE ISOLATED GROUND IN ADDITION TO STANDARD GROUND CONDUCTOR IN ALL CIRCUITING TO I.G. RECEPTACLES. ALL I.G. BRANCH CIRCUITS #10AWG; ALL WITH DEDICATED NEUTRAL.

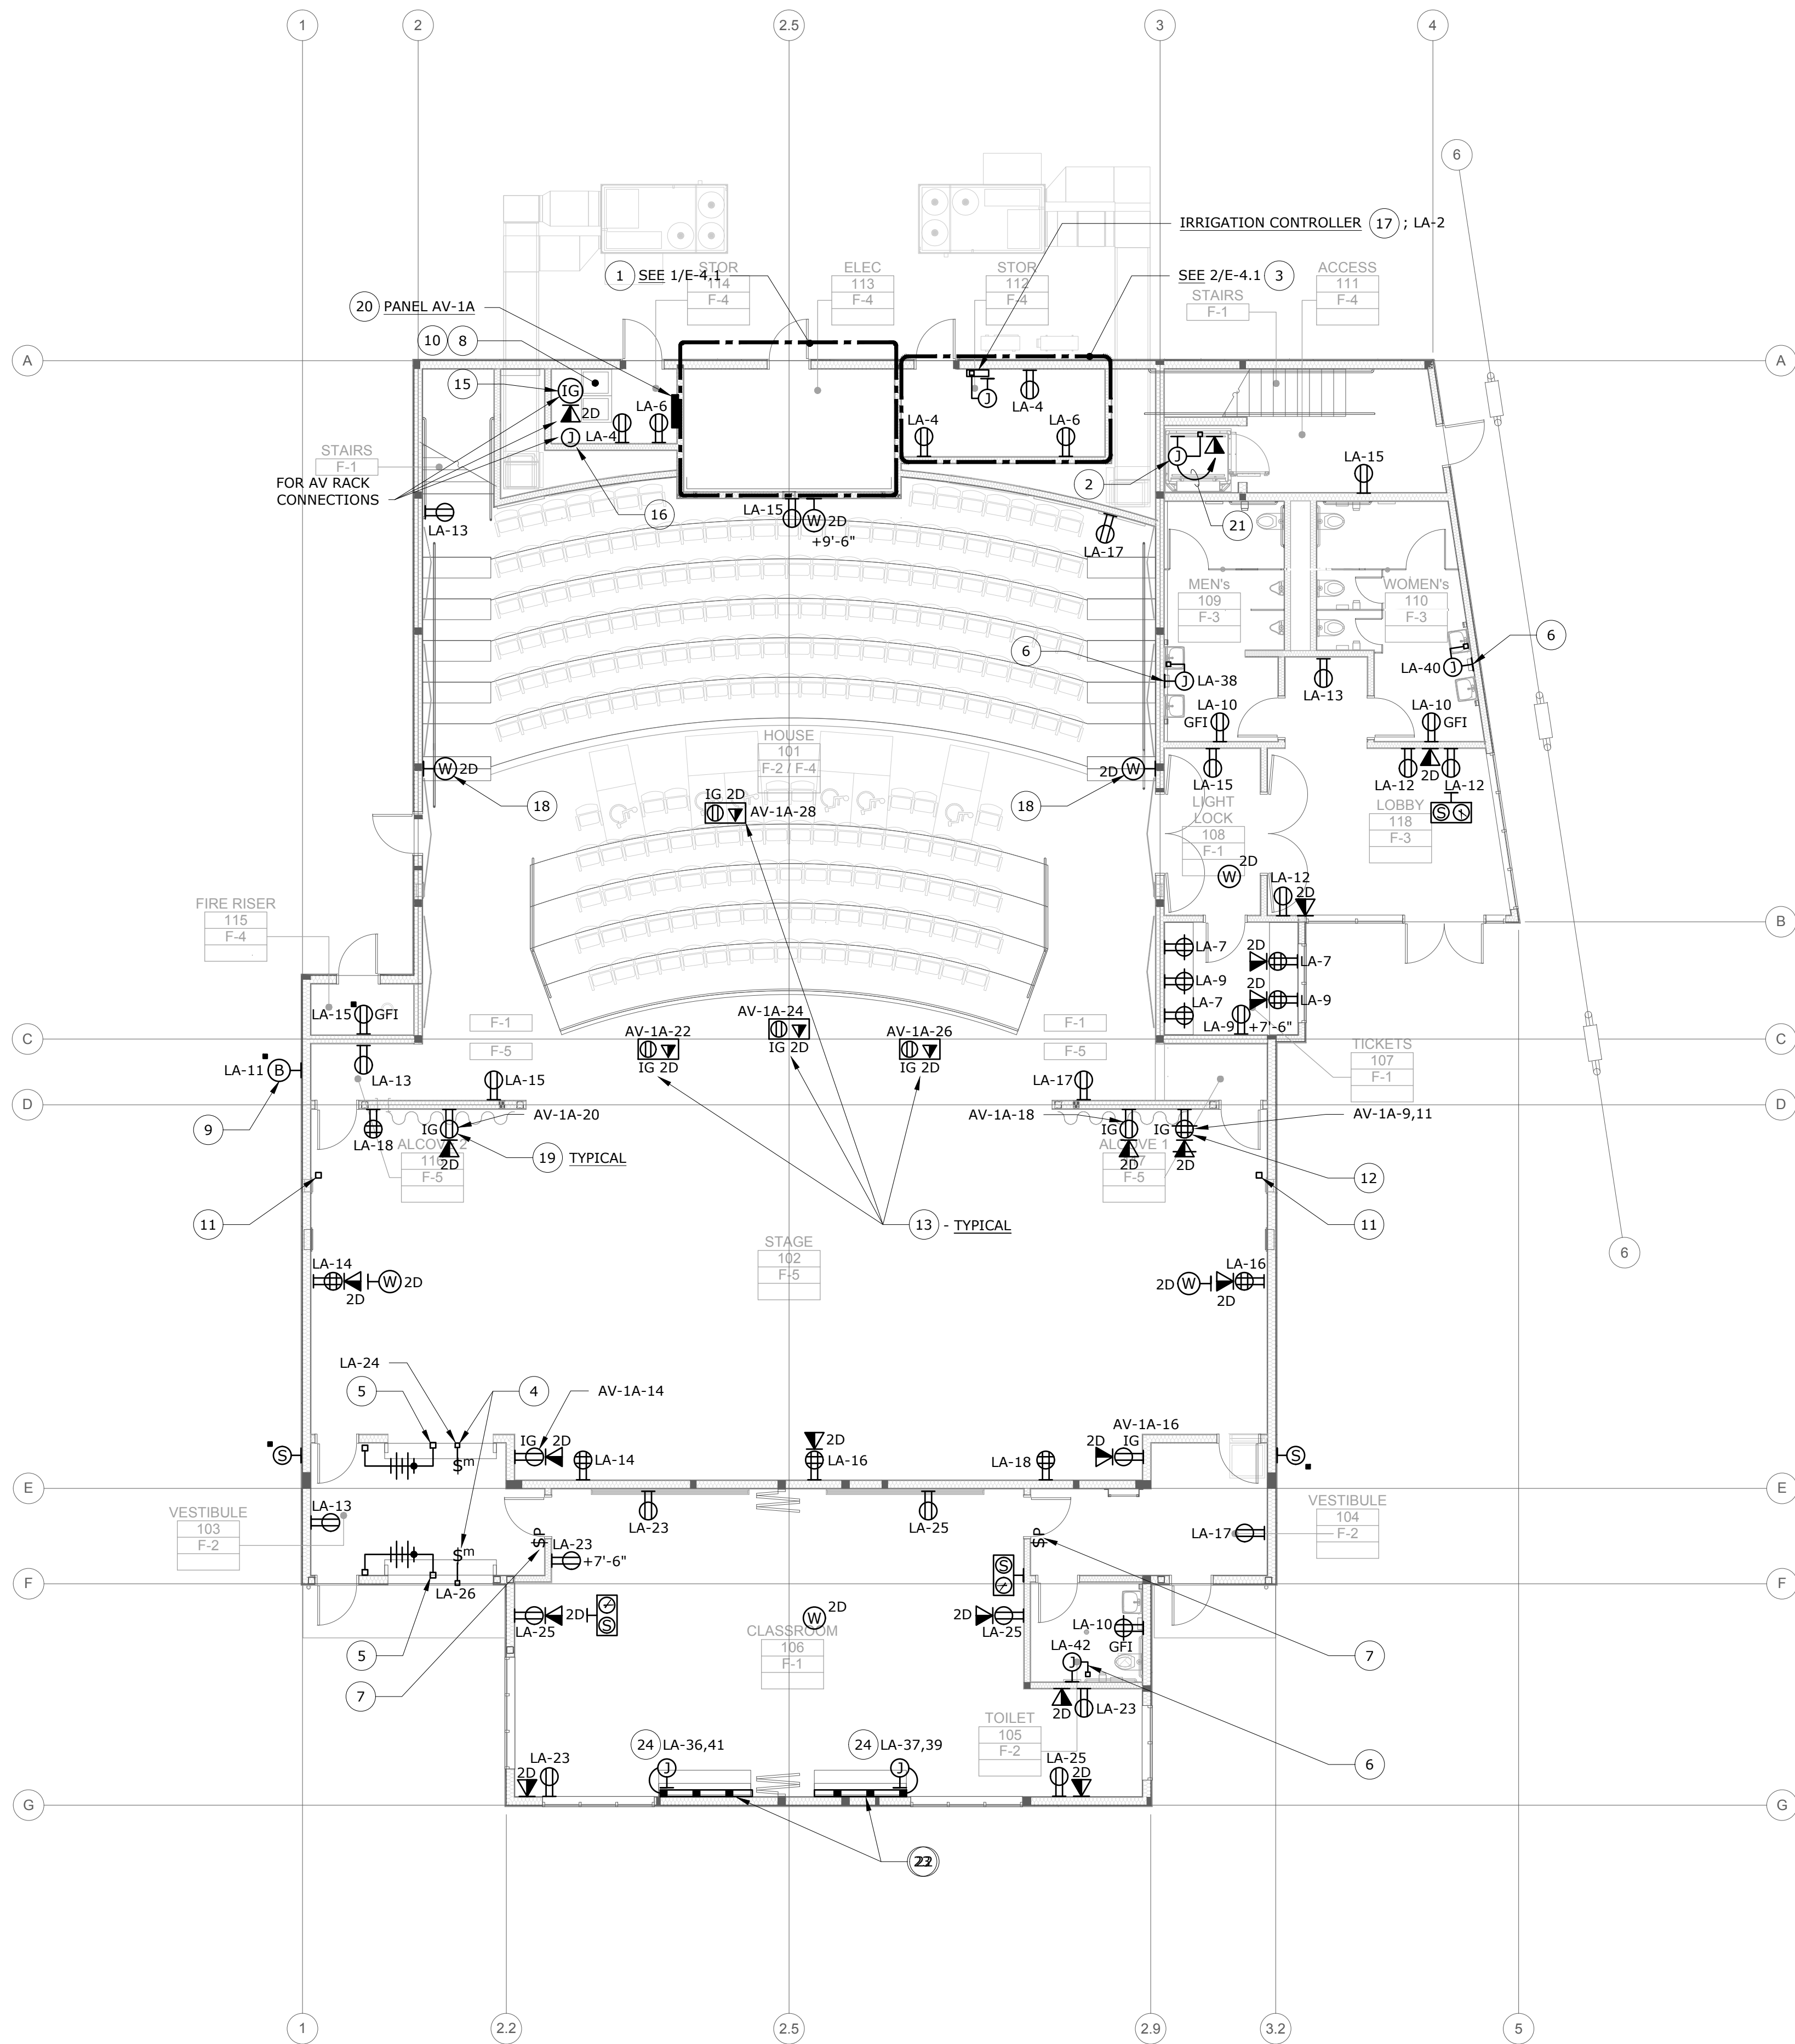


**FLOOR PLAN FIRST LEVEL - POWER & SIGNAL**

SCALE: 1/8" = 1'-0"

## NUMBERED SHEET NOTES

- SEE 1/E-4.1 FOR ELECTRICAL EQUIPMENT LAYOUT THIS AREA.
- CONNECT LIFT COMPLETE VIA INTEGRAL DISCONNECT.
- SEE 2/E-4.1 FOR PRODUCTION LIGHTING EQUIPMENT LAYOUT THIS AREA.
- OVERHEAD COILING DOOR.
- DOOR CONTROLS - VERIFY ALL REQUIREMENTS AND CONNECT COMPLETE.
- ELECTRIC HAND-DRYER - TYPICAL - VERIFY EXACT LOCATION.
- DRESSING ROOM CONTROL STATION - SEE 5/E-7.5.
- LOCATION OF AV RACK - SEE 1/AV-4.01 FOR EXACT LOCATION AND LAYOUT OF RACK.
- CONNECT 120V CIRCUIT FOR BELL VIA FLOW SWITCH AUXILIARY CONTACT IN SPRINKLER RISER ROOM - SEE FE SERIES DRAWINGS FOR LOCATION.
- SEE 1/AV-4.01 FOR CABLE TRAY REQUIREMENTS FOR LOW VOLTAGE AV CABLES ORIGINATING AT RACK.
- SMOKE HATCH RELEASE STATION - SEE 4/E-7.5. PROVIDE ENGRAVED RED NAMEPLATE "SMOKE HATCH RELEASE".
- (2) DEDICATED CIRCUITS; ONE FOR EACH DUPLEX.
- FOR FLOOR BOX REQUIREMENTS AND EXACT LOCATION SEE AV DRAWINGS.
- IN CEILING.
- ISOLATED GROUND CONNECTION TO AV RACK - SEE E-5.1.
- PROVIDE (4) 20A 1P 120V ISOLATED GROUND CIRCUITS FOR AV RACK - AV-1A-1,3,5,7 - CONNECT COMPLETE TO RACK WITH NON-CONDUCTIVE TERMINATION; #10 AWG THROUGHOUT.
- PROVIDE GROUND ROD AND #4G. IN 1" CONDUIT TO CONTROLLER - SEE L5.00.
- MOUNT +9'-6" BETWEEN ACOUSTICAL WALL ELEMENTS.
- SEE GENERAL NOTE 'C' BELOW FOR REQUIREMENTS FOR ALL I.G. BRANCH CIRCUITS.
- CONNECT POWER SUPPLY TO AV-1-1.
- TO DISTRIBUTIONAL PANEL DP-G - SEE E-5.01.
- CONNECT COMPLETE VIA DRESSING STATION CONTROLS - SEE 5/E-7.5.
- 7FT LONG WIREMOLD STRIP ABOVE DRESSING COUNTER W/(4) 20A 125V 3PG SINGLE RECEPTACLES EVENLY SPACED ON ALTERNATING CIRCUITS.
- FLUSH WIREMOLD IN-FEED J-BOX BEHIND WIREMOLD.

NOTE: SEE 'PL' PRODUCTION LIGHTING DRAWINGS, 'PS' AISLE SEAT LIGHTING DRAWINGS AND THEATRICAL AUDIO-VISUAL 'AV' DRAWINGS FOR ADDITIONAL DIVISION 26 SCOPE OF WORK. TYPICAL THIS PROJECT.

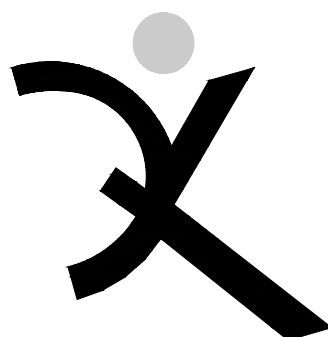

QUATTROCCHI KIVOK  
ARCHITECTS

**Main Office:**  
636 Fifth Street, Santa Rosa, CA 95404  
**Pleasanton Office:**  
600 Main Street, Suite E,  
Pleasanton, CA 94566  
(707) 576-0829



**SAN MARIN  
HIGH SCHOOL**

**PERFORMING  
ARTS BUILDING**

15 SAN MARIN DR  
NOVATO, CA 94945

NOVATO UNIFIED  
SCHOOL DISTRICT

### REVISIONS

NO.	DESCRIPTION	DATE

ARCH PROJECT NO: 1700.02  
DRAWN BY: TV/LN  
DRAWING SCALE: AS NOTED  
PTN: 65417-138

100% CD

FEB 15, 2019

SHEET TITLE

**FLOOR PLAN  
FIRST LEVEL -  
POWER &  
SIGNAL**

SHEET NUMBER

**E-3.1**